



**Self-Diagnostic & Continuous**

# INTELLIGENT EXTRACTIVE GAS DETECTORS SH-1003/1007GT

- ◆ **“Intelligent” sensor assembly permits quick and simple off-site calibration.**
- ◆ **System Status**
  - Disconnect sensor**
  - Low sample flow**
  - Filament failure (SH-1007GT)**
  - Disconnect signal cable**
- ◆ **Same compact size for NF3, PFC detection**



The new Bionics' **SH-1003/7GT** Gas Detectors are designed to set new standards in toxic gas monitoring. Featuring a sophisticated electronic “brain” built directly into the sensor assembly, these well-proven continuous extractive detection systems significantly reduce the labor and downtime commonly associated with gas detector maintenance and service.

Equally important, the **SH-1003/7GT** are specially engineered to permit high-density installation, packing up to 3 times as much monitoring into the same, compact footprint.

The instruments’ “smart” circuitry permits ex-situ or off-site calibration and maintenance of the sensor cell, significantly reducing the amount of time personnel must spend in restricted or sensitive areas. Plus, when used in conjunction with the Bionics Controller, system operation is almost totally self-supervised to provide quick and easy fault identification and notification.

The special electronic “brain” built directly into the sensor assembly of the **SH-1003/7GT** allows you to remove the sensor from the detector system for all routine calibration and maintenance.

This capability provides three important benefits:

1) **Enhanced Calibration Accuracy**

**Test gas generation and calibration procedures may now be performed under laboratory conditions.**

2) **Improved Safety**

**No need to release potentially hazardous calibration gases in production, storage, or other areas.**

3) **Less Intrusive**

**Significantly reduces the amount of time that service personnel must spend in limited or restricted access areas, such as in clean rooms.**

The **SH-1003/7GT** are electrochemical-based detection systems capable of sampling areas up to 10 meters away.

SH-1003GT Detector

| System No.       | Target Gas  |                      | Sensor GT-[*]H<br>(Unless otherwise indicated) | Monitoring Range (ppm)          |          | TLV(ACGIH)<br>(ppm) | Remarks  |
|------------------|---|----------------------|--|---------------------------------|----------|---------------------|--|
|                  |   |                      |  | Low                             | Standard |                     |  |
| 100              | Cl <sub>2</sub>   | Chlorine             | 160  |                                 | 0 - 1.5  | 0.1                 |  |
|                  |   |                      | 161  | 0 - 0.3                         | 0 - 1    |                     |  |
| 200              | H <sub>2</sub> S  | Hydrogen Sulfide     | 260  |                                 | 0 - 30   | 1                   |  |
| 400              | HCl   | Hydrogen Chloride    | 480  | 0 - 6                           | 0 - 15   | 2 (C)               |  |
| 500              | SO <sub>2</sub>   | Sulfur Dioxide       | 550E   |                                 | 0 - 6    | 0.25 (STEL)         |  |
| 700              | HF  | Hydrogen Fluoride    | 780  |                                 | 0 - 9    | 0.5                 |  |
| 800              | O <sub>3</sub>  | Ozone                | 880  | 0 - 0.3                         | 0 - 1    | 0.1                 |  |
| 900              | Br <sub>2</sub>   | Bromine              | 960  |                                 | 0 - 3    | 0.1                 |  |
|                  |   |                      | 961  |                                 | 0 - 0.3  |                     |  |
| 1100             | O <sub>2</sub>  | Oxygen               | 1100E  |                                 | 0 - 25%  |                     | Oxygen deficiency monitoring   |
| 1200             | CO  | Carbon Monoxide      | 1250E  |                                 | 0 - 75   | 25                  |  |
| 1400             | F <sub>2</sub>  | Fluorine             | 1461   | 0 - 1                           | 0 - 3    | 0.1                 |  |
|                  | ClF <sub>3</sub>  | Chlorine Trifluoride | 1463   |                                 | 0 - 0.3  | 0.1 (C)             |  |
| 1500             | H <sub>2</sub>  | Hydrogen             | 1555E  | 0 - 1000                        | 0 - 4000 | —                   |  |
| 1700             | NO  | Nitric Oxide         | 1790E  |                                 | 0 - 100  | 25                  |  |
|                  | NO <sub>2</sub>   | Nitrogen Dioxide     | 1750E  |                                 | 0 - 9    | 0.2                 |  |
|                  | HNO <sub>3</sub>  | Nitric Acid          | 1783   |                                 | 0 - 6    | 2                   |  |
| 2100             | C <sub>2</sub> H <sub>5</sub> OH                              | Ethyl Alcohol        | 2150E  |                                 | 0 - 1000 | 1000 (STEL)         |  |
|                  | IPA   | Iso Propyl Alcohol   |  |                                 | 0 - 600  | 200                 |  |
| 2400             | NH <sub>3</sub>   | Ammonia              | 2460   |                                 | 0 - 75   | 25                  |  |
|                  | CH <sub>3</sub> NH <sub>2</sub>                               | Methylamine          |  |                                 | 0 - 30   | 5                   |  |
|                  | C <sub>2</sub> H <sub>5</sub> NH <sub>2</sub>                 | Ethylamine           |  |                                 | 0 - 30   | 5                   |  |
|                  | (CH <sub>3</sub> ) <sub>2</sub> NH                            | Dimethylamine        |  |                                 | 0 - 30   | 5                   |  |
| 2500             | N <sub>2</sub> H <sub>4</sub> <sup>1)</sup>                   | Hydrazine            | 2560   |                                 | 0 - 2    | 0.01                | Under N <sub>2</sub> condition   |
|                  | Ti[N(CH <sub>3</sub> ) <sub>2</sub> ] <sub>4</sub>            | TDMAT <sup>2)</sup>  |  |                                 | 0 - 1    |                     |  |
|                  | C <sub>2</sub> H <sub>4</sub> (NH <sub>2</sub> ) <sub>2</sub> | Ethylene Diamine     |  |                                 | 0 - 300  | 10                  |  |
| 3100             | General Acid  |                      | 3180   | Depending on gas to be detected |          | —                   |  |
| 3200             | H <sub>2</sub> Se   | Hydrogen Selenide    | 3260   |                                 | 0 - 1    | 0.05                |  |
| 3400             | Chloride <sup>3)</sup>  |                      | 3480   |                                 | 0 - 6    | —                   |  |
|                  | HBr   | Hydrogen Bromine     | 3480   |                                 | 0 - 9    | 2 (C)               |  |
| 3700             | Fluoride <sup>4)</sup>  |                      | 3780   |                                 | 0 - 9    | —                   |  |
| 4000             | Hydride   |                      | 4060   |                                 |          |                     | For dry scrubber monitoring<br>No interference from H <sub>2</sub> and IPA |
|                  | PH <sub>3</sub>   | Phosphine            |  |                                 | 0 - 1    | 0.05                |  |
|                  | AsH <sub>3</sub>  | Arsine               |  |                                 | 0 - 0.2  | 0.005               |  |
|                  | SiH <sub>4</sub>  | Silane               |  |                                 | 0 - 15   | 5                   |  |
| 5000             | B <sub>2</sub> H <sub>6</sub>                                 | Diborane             | 5050E  |                                 | 0 - 0.3  | 0.1                 |  |
|                  | GeH <sub>4</sub>  | Germane              |  |                                 | 0 - 0.6  | 0.2                 |  |
|                  | SiH <sub>4</sub>  | Silane               |  |                                 | 0 - 15   | 5                   |  |
|                  | PH <sub>3</sub>   | Phosphine            |  |                                 | 0 - 1    | 0.05                |  |
|                  | (CH <sub>3</sub> ) <sub>3</sub> SiH                           | Trimethyl Silane     |  |                                 | 0 - 15   |                     |  |
|                  | CH <sub>3</sub> SiH <sub>3</sub>                              | Methyl Silane        |  |                                 | 0 - 15   |                     |  |
| AsH <sub>3</sub> | Arsine  |                      | 0 - 0.2  | 0.005                           |          |                     |  |

<sup>1)</sup> N<sub>2</sub>H<sub>4</sub>: MMH– Monomethyl Hydrazine, DMH– Dimethyl Hydrazine

<sup>2)</sup> TDMAT: Tetrakis dimethylamido titanium

<sup>3)</sup> Chloride: SiCl<sub>4</sub>, SiH<sub>2</sub>Cl<sub>2</sub>, POCl<sub>3</sub>, SnCl<sub>4</sub>, SbCl<sub>5</sub>, BCl<sub>3</sub>

<sup>4)</sup> Fluoride: SiF<sub>4</sub>, BF<sub>3</sub>, WF<sub>6</sub>, AsF<sub>3</sub>, PF<sub>5</sub>, AsF<sub>5</sub>, MoF<sub>6</sub>

## SH-1007GT Detector

| System No. | Target Gas                             |                      | Sensor GT-[*]H | Monitoring Range (ppm)                        |          | TLV(ACGIH) (ppm) | Remarks                                 |
|------------|--|----------------------|----------------|---|----------|------------------|---|
|            |  |                      |                | Low   | Standard |                  |   |
| 4100       | NF <sub>3</sub>                        | Nitrogen Trifluoride | 4180           |   | 0 - 30   | 10               | CEC<br>(Combined Electro-chemical Cell) |
| 4200       | HCFC <sup>5)</sup>                     |                      | 4280           |   | 0 - 200  |                  |   |
| 4300       | Chlorinated Hydrocarbons <sup>6)</sup> |                      | 4380           |   | 0 - 200  |                  |   |
| 4400       | CH <sub>3</sub> Br                     | Methyl Bromide       | 4460           |   | 0 - 50   | 1                |   |
| 4500       | SF <sub>6</sub>                        | Sulfur Hexafluoride  | 4580           |   | 0 - 200  | 1000             |   |
| 4700       | HFC <sup>7)</sup>                      |                      | 4780           | Depending on gas to be detected <sup>9)</sup> |          | –                |   |
|            | PFC <sup>8)</sup>                      |                      |                |   |          | –                |   |
| 4900       | CH <sub>2</sub> =CHCN                  | Acrylonitrile        | 4960           |   | 0 - 60   | 2                |   |

### 5) HCFC

HCFC-22      CHClF<sub>2</sub>  
 HCFC-123    CHClCF<sub>3</sub>

### 7) HFC

HFC-23      CHF<sub>3</sub>  
 HFC-134a    CH<sub>2</sub>FCF<sub>3</sub>

### 6) Chlorinated Hydrocarbon

Carbon Tetrachloride    CCl<sub>4</sub>  
 Chloromethane          CH<sub>3</sub>Cl  
 Methylene Chloride    CH<sub>2</sub>Cl<sub>2</sub>  
 Chloroform              CHCl<sub>3</sub>  
 1, 2-Dichloroethylene    C<sub>2</sub>H<sub>2</sub>Cl<sub>2</sub>  
 Chloroethane            C<sub>2</sub>H<sub>5</sub>Cl

### 8) PFC

CF<sub>4</sub>    C<sub>2</sub>F<sub>6</sub>    C<sub>3</sub>F<sub>6</sub>    C<sub>3</sub>F<sub>8</sub>  
 C<sub>4</sub>F<sub>6</sub>    C<sub>4</sub>F<sub>8</sub>    C<sub>5</sub>F<sub>8</sub>    C<sub>6</sub>F<sub>6</sub>

### 9) Monitoring ranges available upon request.

Example: 5000 ppm for CF<sub>4</sub>

**SENSORS**

SH-1003/1007GT




GT-[\*]H  
(renewable)



GT-[\*]E  
(disposable)

|                          | SH-1003GT                            | SH-1007GT                     |
|--------------------------|--------------------------------------|-------------------------------|
| Sensor Model             | GT-[*]H / E                          |                               |
| Monitoring Configuration | Continuous, single-point, extractive |                               |
| Sensor Type              | Electrochemical Cell                 | Combined Electrochemical Cell |
| Pyrolyzer                | Not provided                         | Built-in                      |
| Analog Output            | 4 ~ 20 mA DC                         |                               |
| Indicator                | Analog Display                       |                               |
| Installation Method      | Indoor, Wall-mount                   |                               |
| Operating Temperature    | 0 ~ 40 °C                            |                               |
| Operating Humidity       | 20 ~ 85% RH (Condensation-free)      |                               |
| Power Requirement        | 24V DC, 10W                          |                               |
| Dimensions (mm)          | 110(W) × 210(H) × 174(D)             |                               |
| Weight                   | Approx. 4kg                          |                               |

# DIMENSIONS

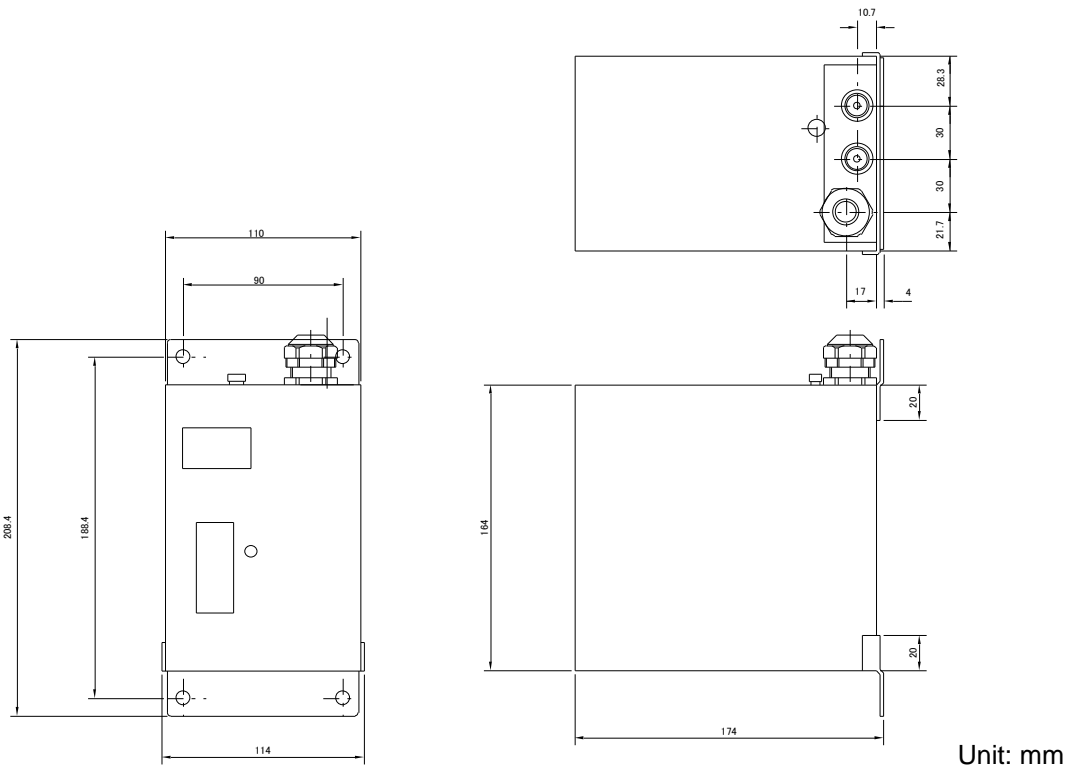

※We reserve the right to change specifications without notice.

**Bionics Instrument Co., Ltd.**

6-1254-2 Shimizu, Higashi-yamato, Tokyo, 207-0004 Japan.  
 TEL: +81-42-561-4856 FAX: +81-42-563-9228  
 e-mail: [trade@bionics-japan.co.jp](mailto:trade@bionics-japan.co.jp) URL: <https://www.bionics-japan.co.jp/en/>

**PureAire Monitoring Systems Inc.**

1140 Ensell Road, Lake Zurich, Illinois 60047-6711, USA.  
 TEL: +1-847-726-6000 FAX: +1-847-726-6051 Toll Free: 888-788-8050  
 e-mail: [info@pureaire.net](mailto:info@pureaire.net) URL: <http://www.pureairemonitoring.com>

**Global Bionics Trading Corp.**

No.18, Alley 29, Lane 335, Chenggong Rd., Hukou Township, Hsinchu County 30345, Taiwan.  
 TEL: +886-3-553-8986 FAX: +886-3-553-8987  
 e-mail: [gbionics@ms56.hinet.net](mailto:gbionics@ms56.hinet.net) URL: <http://www.bionics.com.cn>

**Advan Analytical**

18 Boon Lay Way, #04-116 Tradehub 21, Singapore 609966.  
 TEL: +65-6908-1512 FAX: +65-6255-7902  
 e-mail: [bionics@advananalytical.com](mailto:bionics@advananalytical.com) URL: <http://www.advananalytical.com>